


FIRE RESISTANT TANKS

(SHALL NOT EXCEED 12,000 GALLONS)
EXCEPT FLEET FUELING

Protection by Distance

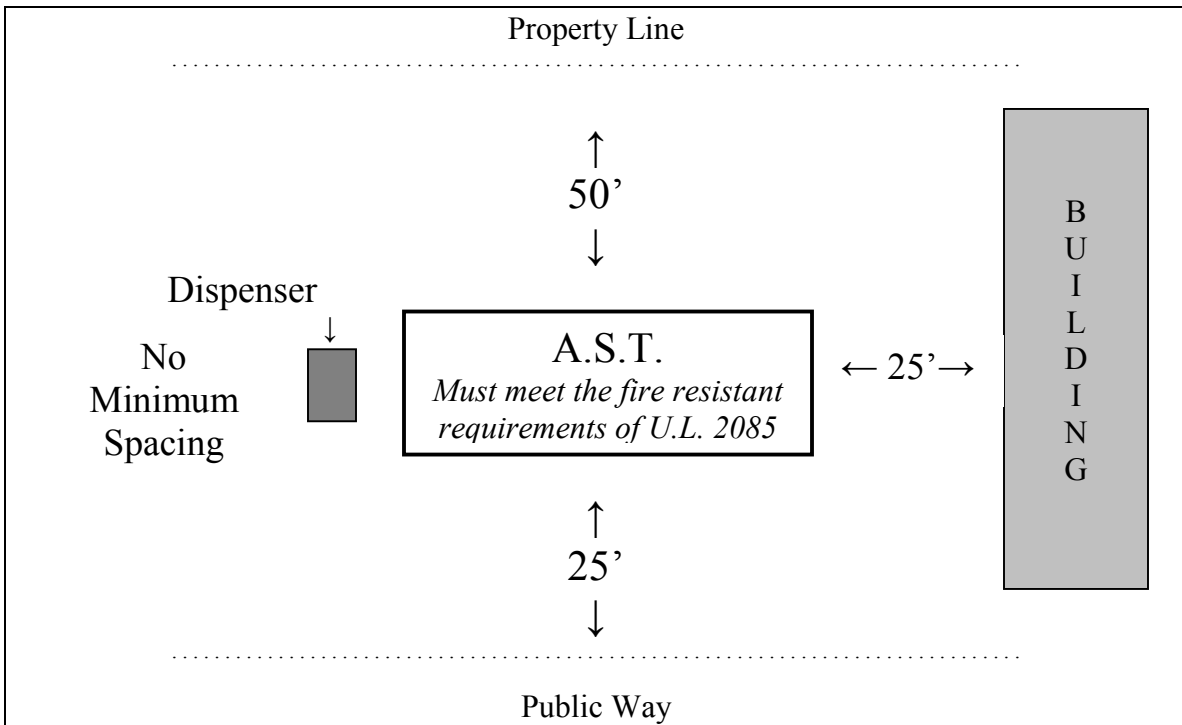

N.F.P.A. 30A 2003 ed.

Fire Resistant Tanks must ALSO meet the fire resistant requirements of U.L. 2085